



PARKWAY COVER ASSEMBLY

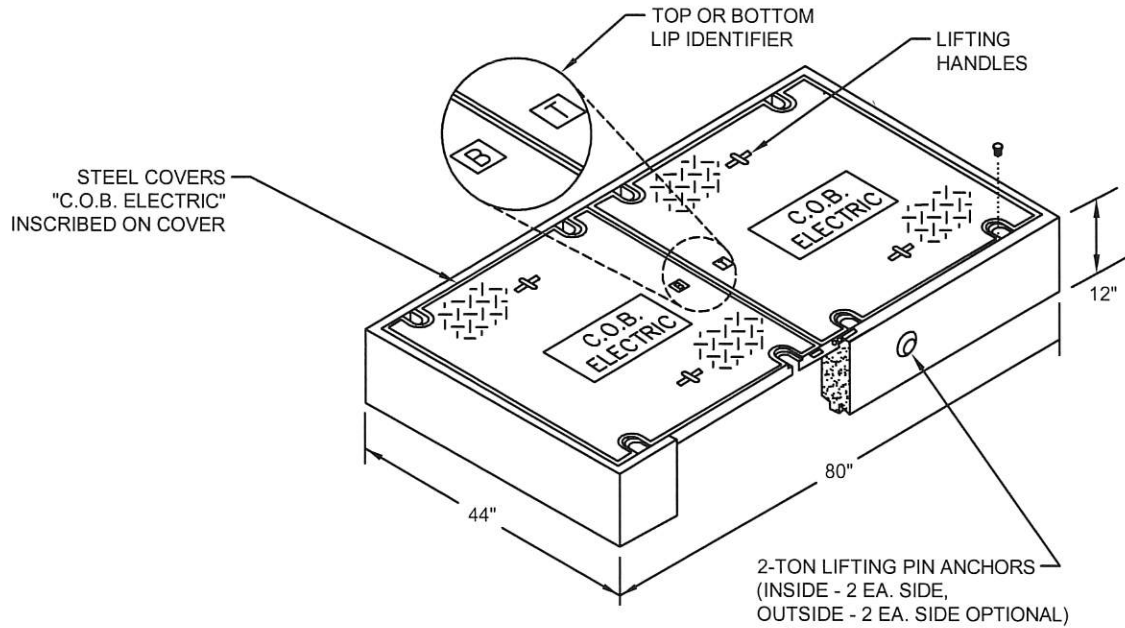

NOTES:

1. LOCATE VAULT AS DIRECTED BY C.O.B. ELECTRIC UTILITY.
2. INSTALL GROUNDING PER C.O.B. STANDARD DRAWING #600-20.
3. INSTALL A MINIMUM 8" OF 3/4" CRUSHED ROCK UNDER VAULT.
4. ALLOW UP TO 3" OF EXTRA EXCAVATION DEPTH FOR ADJUSTING LID TO FINAL GRADE.
5. IF TRAFFIC RATED LID IS REQUIRED CONSULT THE MANUFACTURE FOR AVAILABILITY.

REF: 3314.1



REVISED: 07/27/2017

APPROVED: *[Signature]*

STANDARD DRAWINGS

CONCRETE VAULT COVER, 36"x72"

SD

600-51